


Downey - 6-story Hospital CGS Sta 14M02

Rcd of Fri Jun 10, 2016 01:03:34.0 PDT*

Frequency Band Processed: 6.0 secs to 40.0 Hz

CISN/CSMIP Preliminary Strong Motion Processing - Subject to Revision

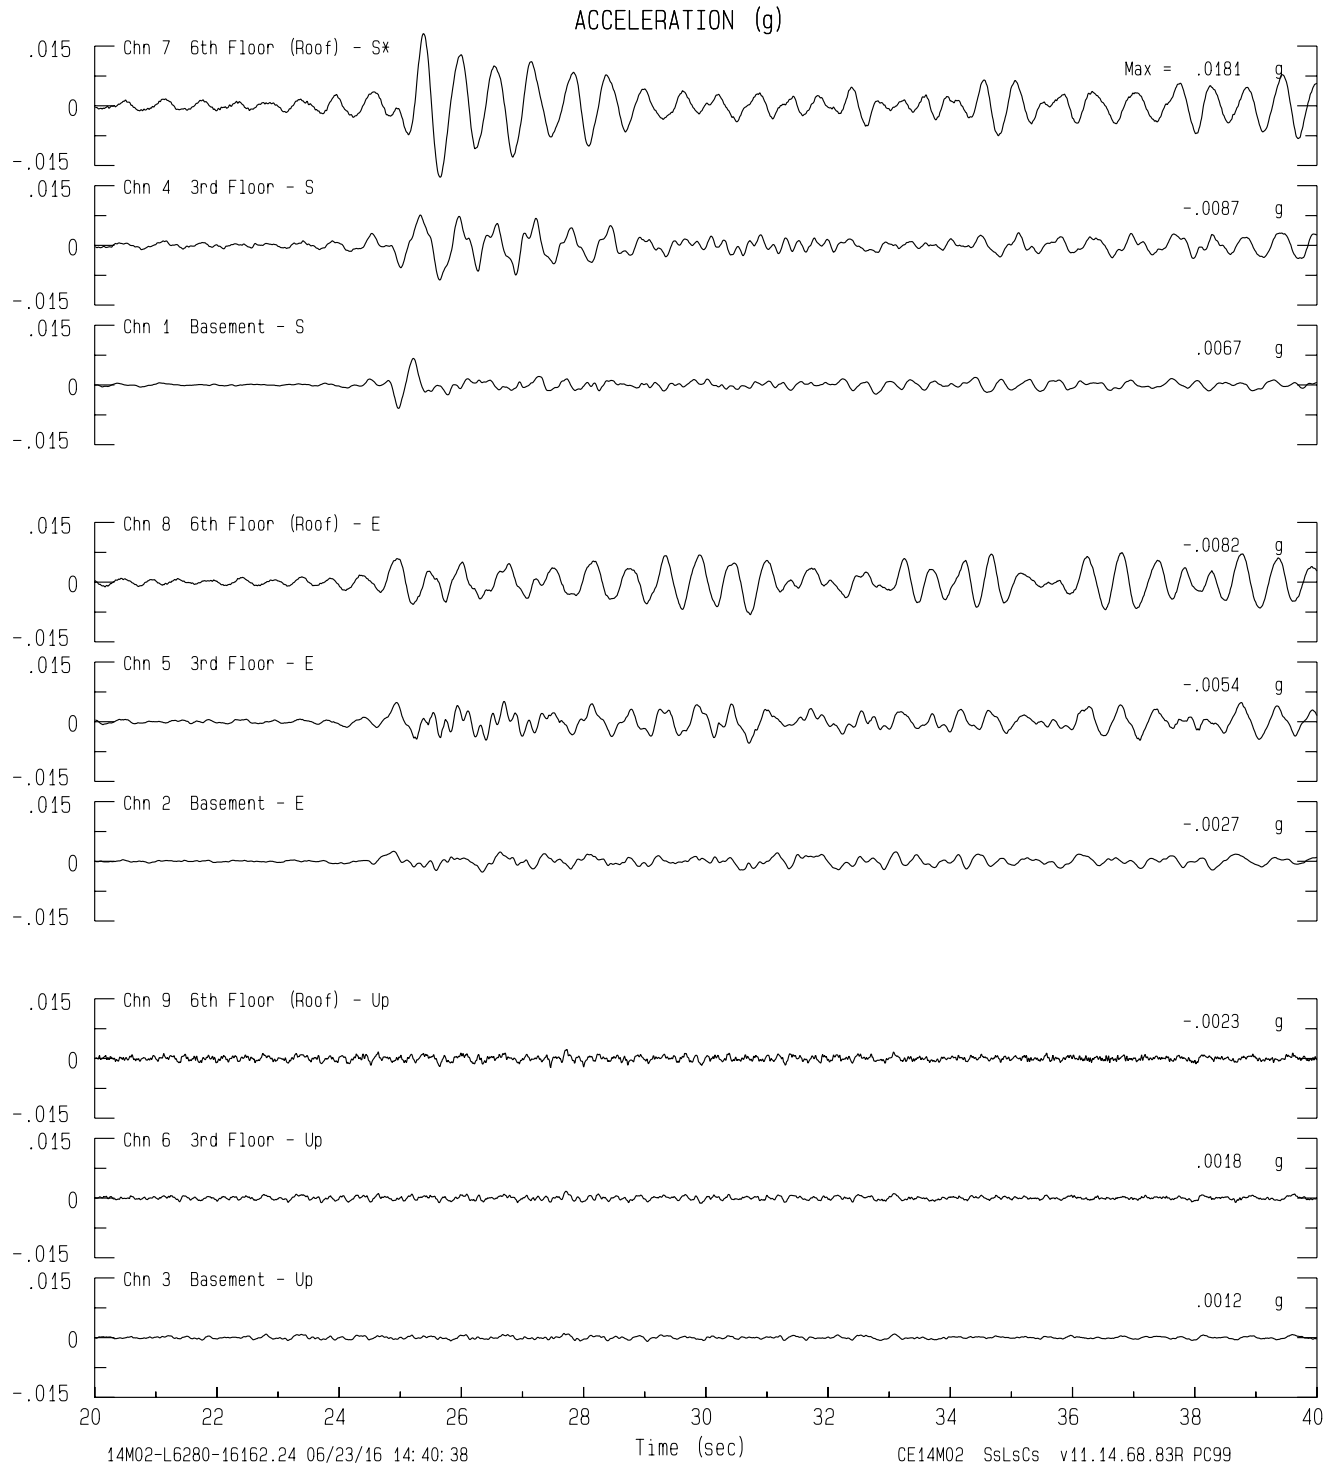


Downey - 6-story Hospital CGS Sta 14M02

Rcd of Fri Jun 10, 2016 01:03:34.0 PDT*

Frequency Band Processed: 6.0 secs to 40.0 Hz

CISN/CSMIP Preliminary Strong Motion Processing - Subject to Revision

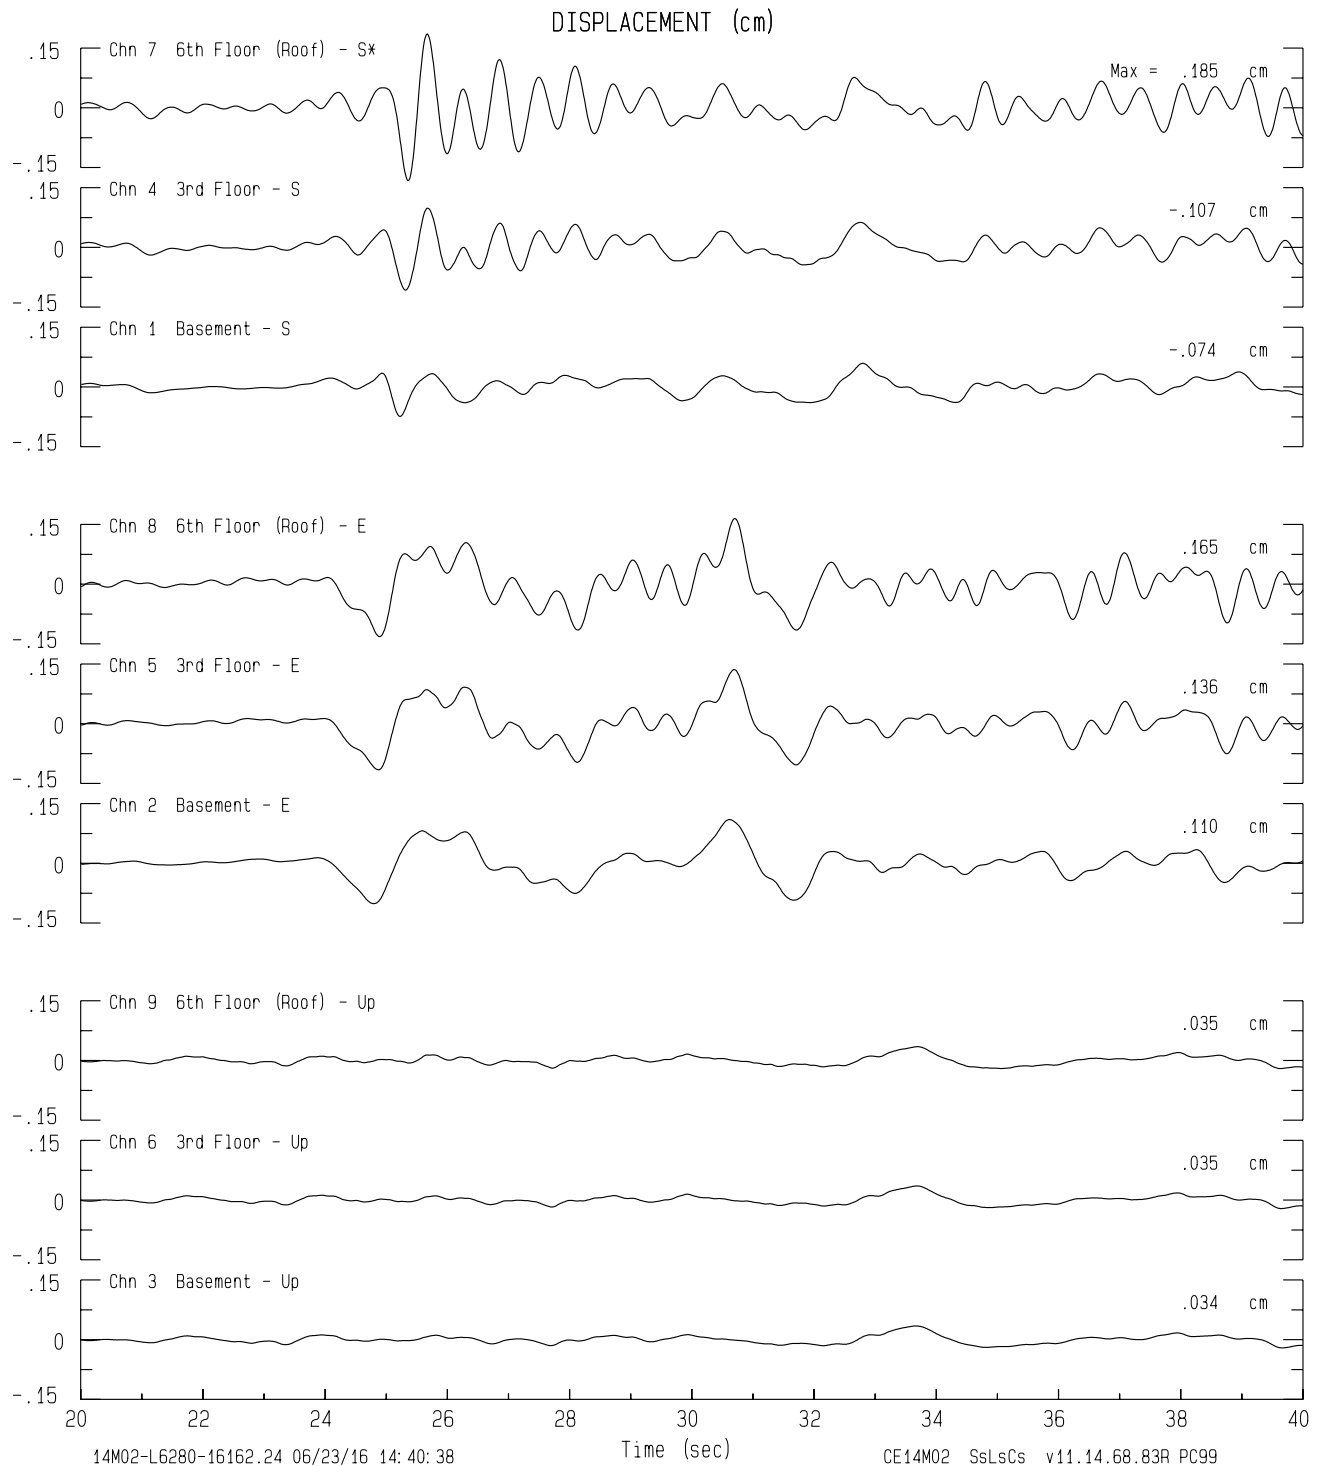

Downey - 6-story Hospital CGS Sta 14M02
 Rcrd of Fri Jun 10, 2016 01:03:34.0 PDT*
 Frequency Band Processed: 6.0 secs to 40.0 Hz
 Automated Strong Motion Processing - Preliminary and Subject to Revision

