


Pasadena - 7-story Hospital CGS Sta 24M01

Rcd of Fri Jun 10, 2016 01:04:46.0 PDT*

Frequency Band Processed: 8.0 secs to 40.0 Hz

CISN/CSMIP Preliminary Strong Motion Processing - Subject to Revision

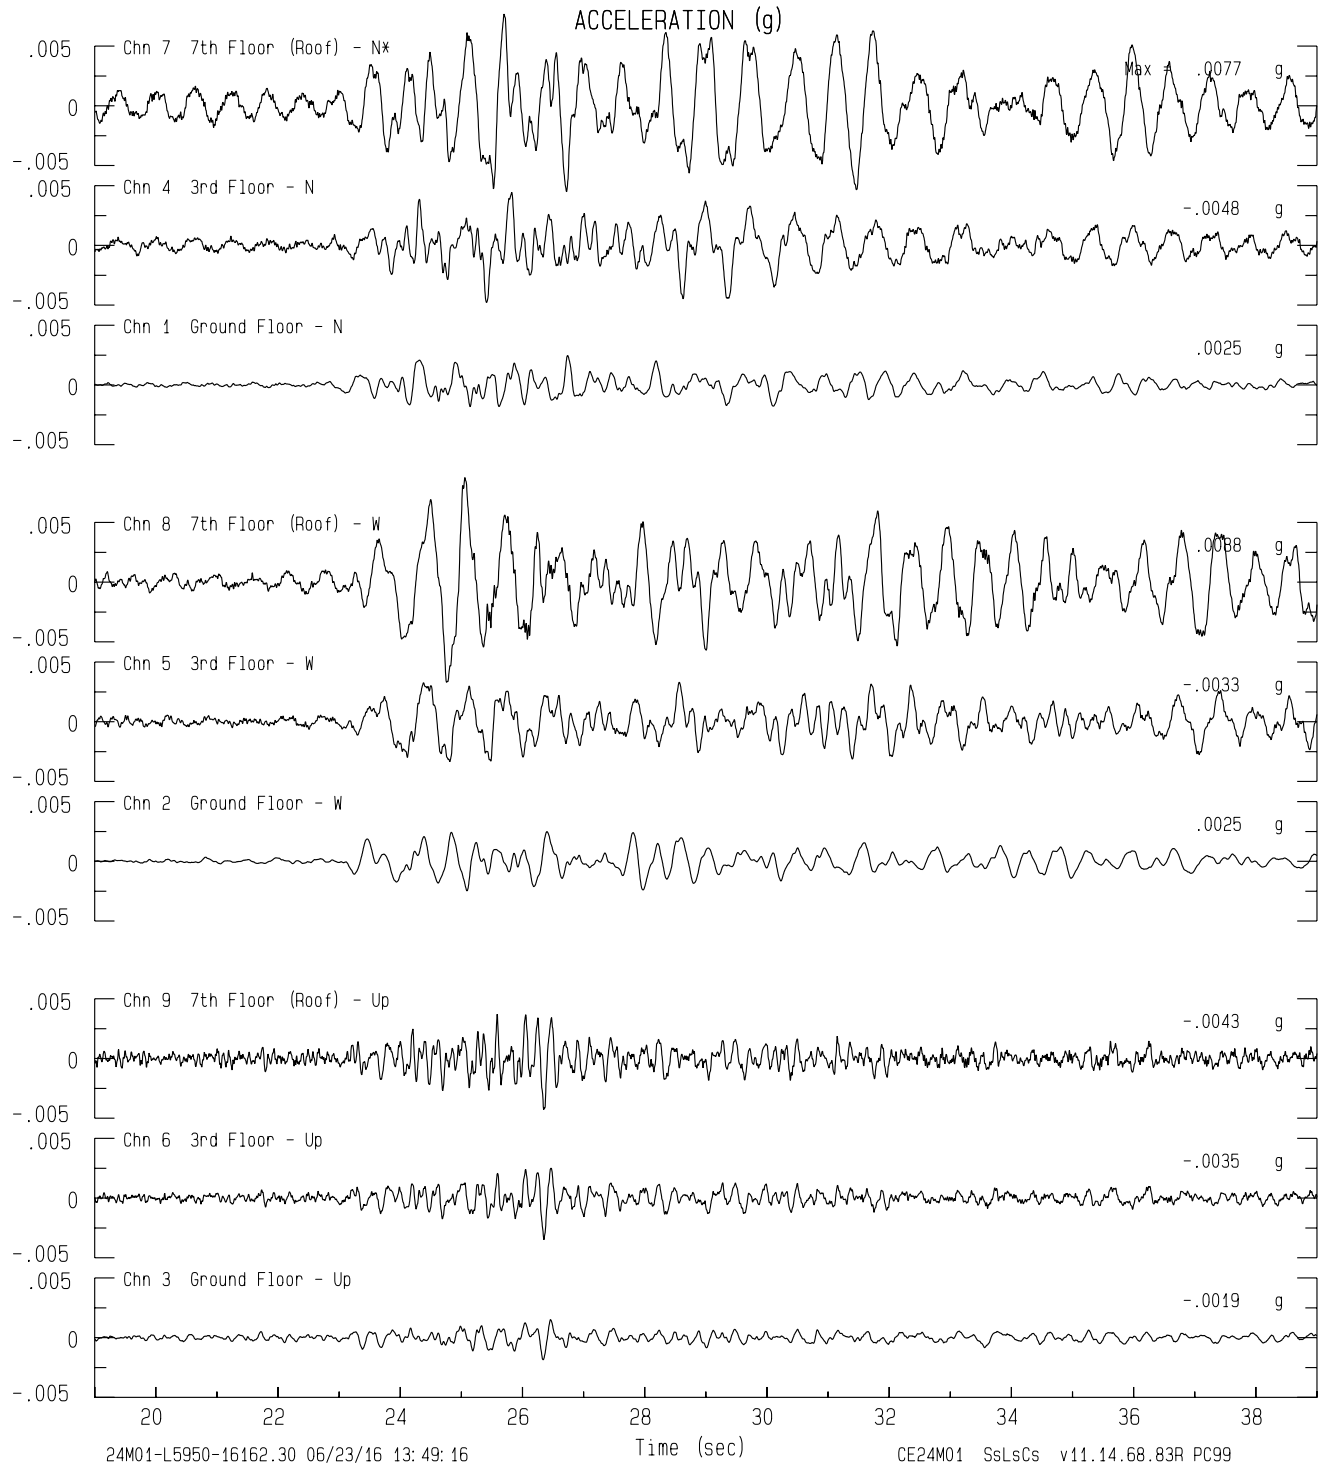


Pasadena - 7-story Hospital CGS Sta 24M01

Rc'd of Fri Jun 10, 2016 01:04:46.0 PDT*

Frequency Band Processed: 8.0 secs to 40.0 Hz

CISN/CSMIP Preliminary Strong Motion Processing - Subject to Revision

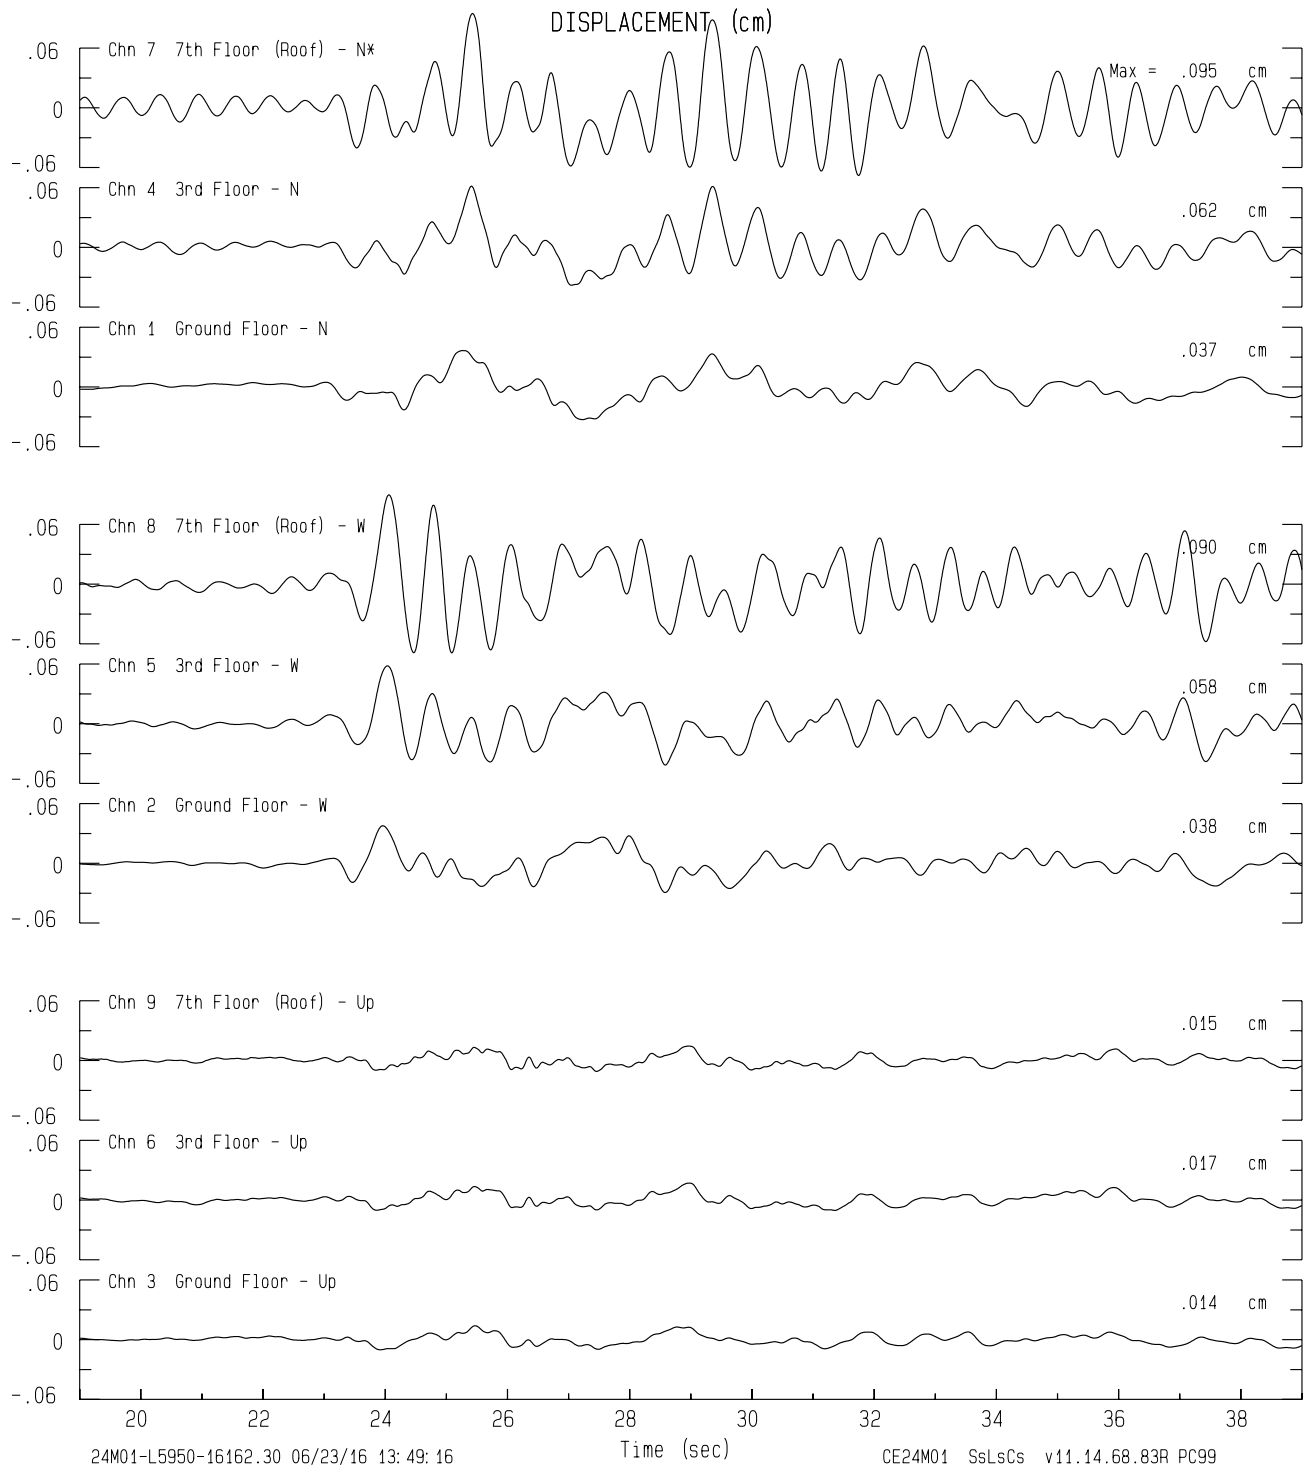

Pasadena - 7-story Hospital CGS Sta 24M01
Rcrd of Fri Jun 10, 2016 01:04:46.0 PDT*
Frequency Band Processed: 8.0 secs to 40.0 Hz
Automated Strong Motion Processing - Preliminary and Subject to Revision

